



AIR/GAS QUALITY REPORT & CERTIFICATE



The air/gas analyzed on 7/12/2017 satisfies the guidelines for

CGA E (G-7.1, 2011)


KOMPTEC

COMPRESSOR KT 90A

Client ID: NA Agent ID: COMP92806 COMPRESSED AIR SPECIALTIES

Kit #: 360338 Frequency: Single		
Analytes	7/12/2017	Range
	326884.SPA	
Oxygen (%)	21.5	20-22
Carbon Dioxide (ppm)	65.28	1000
Carbon Monoxide (ppm)	<1	10
T.H.C. (ppm)	<1	25
Water Vapor (ppm)	11.48	67
Dew Point (F)	-74	-50
Oil/Part. (mg/m3)	<1	5
Unknowns	ND	NA
Odor	ND	None


Results: Sample Meets Standard

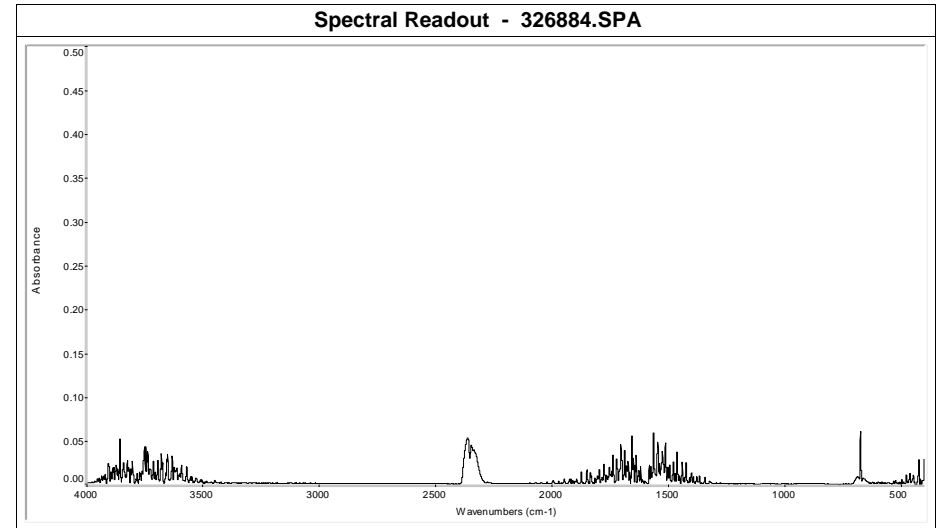


IMPORTANT: This air/gas or substance was tested ONLY against a specified standard and may contain undetected items which are beyond the purpose or scope of this analysis. More extensive testing can be conducted upon request. This does NOT guarantee the condition nor safe

Measurements of Uncertainty values for the reported analytes are available upon request. This report / certificate is not issued for an unbounded duration. Kit#: 360338 - Frequency: Single - Date Received: 7/7/2017 - Issue ID: LF326884 - Page 1 of 1




Endorsement / President


Endorsement / Technician